


**PLAN VIEW**

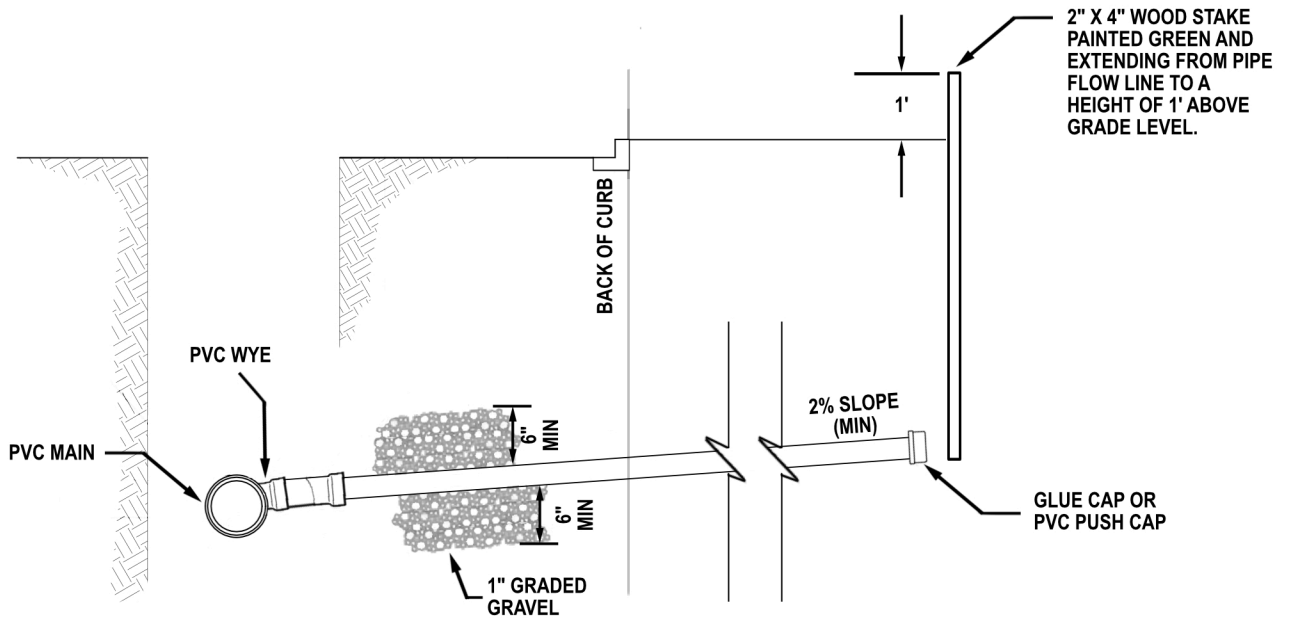

**PROFILE VIEW**

SEE RESOLUTION  
NO. 104  
FOR CLEANOUT  
INFORMATION.

**NOTES:**

- 1 - BUILDING SEWERS MUST BE 4 INCH OR LARGER PIPE DIAMETER. PVC PIPE SHALL BE SDR-35 AND SHALL BE GREEN IN COLOR.
- 2 - BUILDING SEWERS SHALL CONNECT TO THE MAIN USING A "WYE" CONNECTION. WHERE 2 OPPOSING BUILDING SEWER CONNECTIONS ARE WITHIN 4 FEET OF EACH OTHER, A SERIES OF 2, 8" X 4" PVC GASKET BELL & SPIGOT "WYE" FITTINGS IS REQUIRED.
- 3 - A GLUE CAP OR PVC PUSH CAP IS REQUIRED AT THE END OF EACH BUILDING SEWER. "BRANDT" PLUGS ARE NOT ALLOWED.
- 4 - THE BEDDING MATERIAL SHALL BE 1-INCH GRADED GRAVEL, WELL HAUNCHED. IF THE NATIVE MATERIAL IS SAND, IT MAY BE USED, WELL HAUNCHED.
- 5 - THE MINIMUM COVER OVER THE TOP OF THE PIPE SHALL BE 3 FEET.

SCALE: NONE

ORIGINAL			SOUTH DAVIS SEWER DISTRICT		SCALE: NONE
04/11/2019	LBH				SHEET:
REVISIONS			BUILDING SEWER CONNECTION TO SEWER MAIN (NEW CONSTRUCTION)		114-2
07/02/2020	LBH				
07/14/2020	LBH				
10/06/2021	LBH				