


**PLAN VIEW**

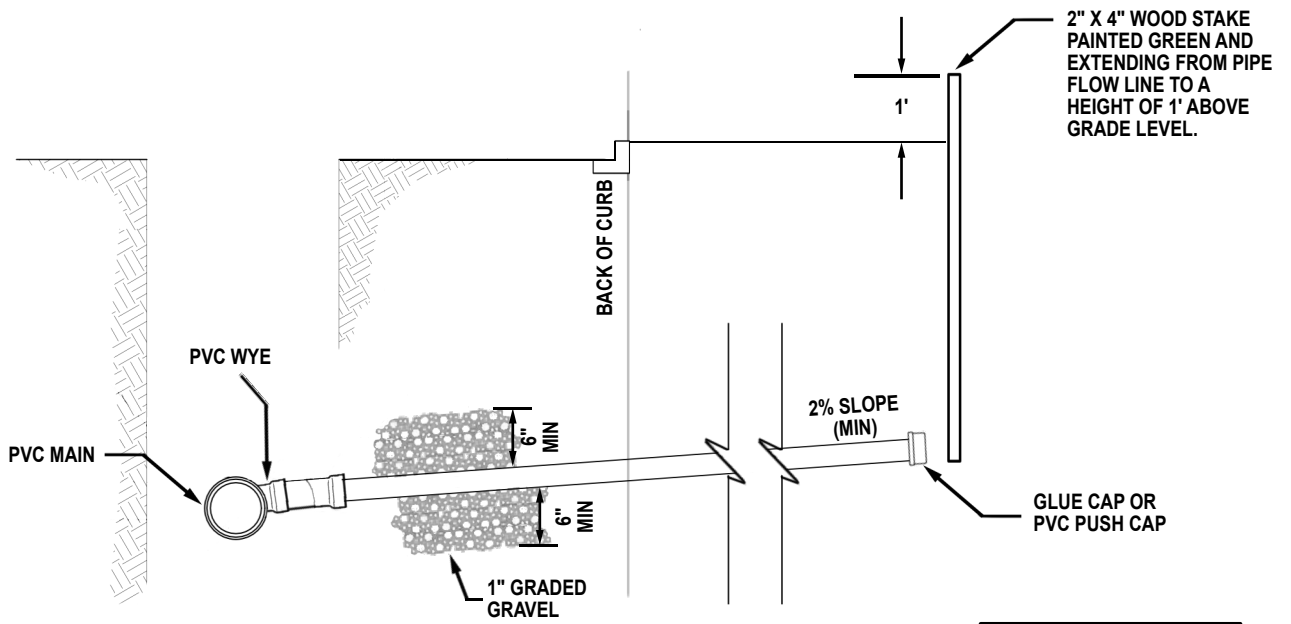

**PROFILE VIEW**

SEE RESOLUTION NO. 104 FOR CLEANOUT INFORMATION.

**NOTES:**

- 1 - GRAVITY BUILDING SEWERS MUST BE 4 INCH OR LARGER PIPE DIAMETER. PVC PIPE SHALL BE SDR-35 AND SHALL BE GREEN IN COLOR.
- 2 - BUILDING SEWERS SHALL CONNECT TO THE MAIN USING A "WYE" CONNECTION. WHERE 2 OPPOSING BUILDING SEWER CONNECTIONS ARE WITHIN 4 FEET OF EACH OTHER, A SERIES OF 2, 8" X 4" PVC GASKET BELL & SPIGOT "WYE" FITTINGS IS REQUIRED.
- 3 - A GLUE CAP OR PVC PUSH CAP IS REQUIRED AT THE END OF EACH BUILDING SEWER. "BRANDT" PLUGS ARE NOT ALLOWED.
- 4 - THE BEDDING MATERIAL SHALL BE 1-INCH GRADED GRAVEL, WELL HAUNCHED. IF THE NATIVE MATERIAL IS SAND, IT MAY BE USED, WELL HAUNCHED.
- 5 - THE MINIMUM COVER OVER THE TOP OF THE PIPE SHALL BE 3 FEET.

SCALE: NONE

ORIGINAL	
04/11/2019	LBH
REVISIONS	
07/02/2020	LBH
07/14/2020	LBH
10/06/2021	LBH
06/13/2023	LBH

**SOUTH DAVIS SEWER DISTRICT**  
**BUILDING SEWER CONNECTION TO SEWER MAIN (NEW CONSTRUCTION)**



SHEET:  
**114-2**